


SUPPLY AIR FILTER AND RETURN AIR DUCT
SMOKE DETECTION SYSTEM

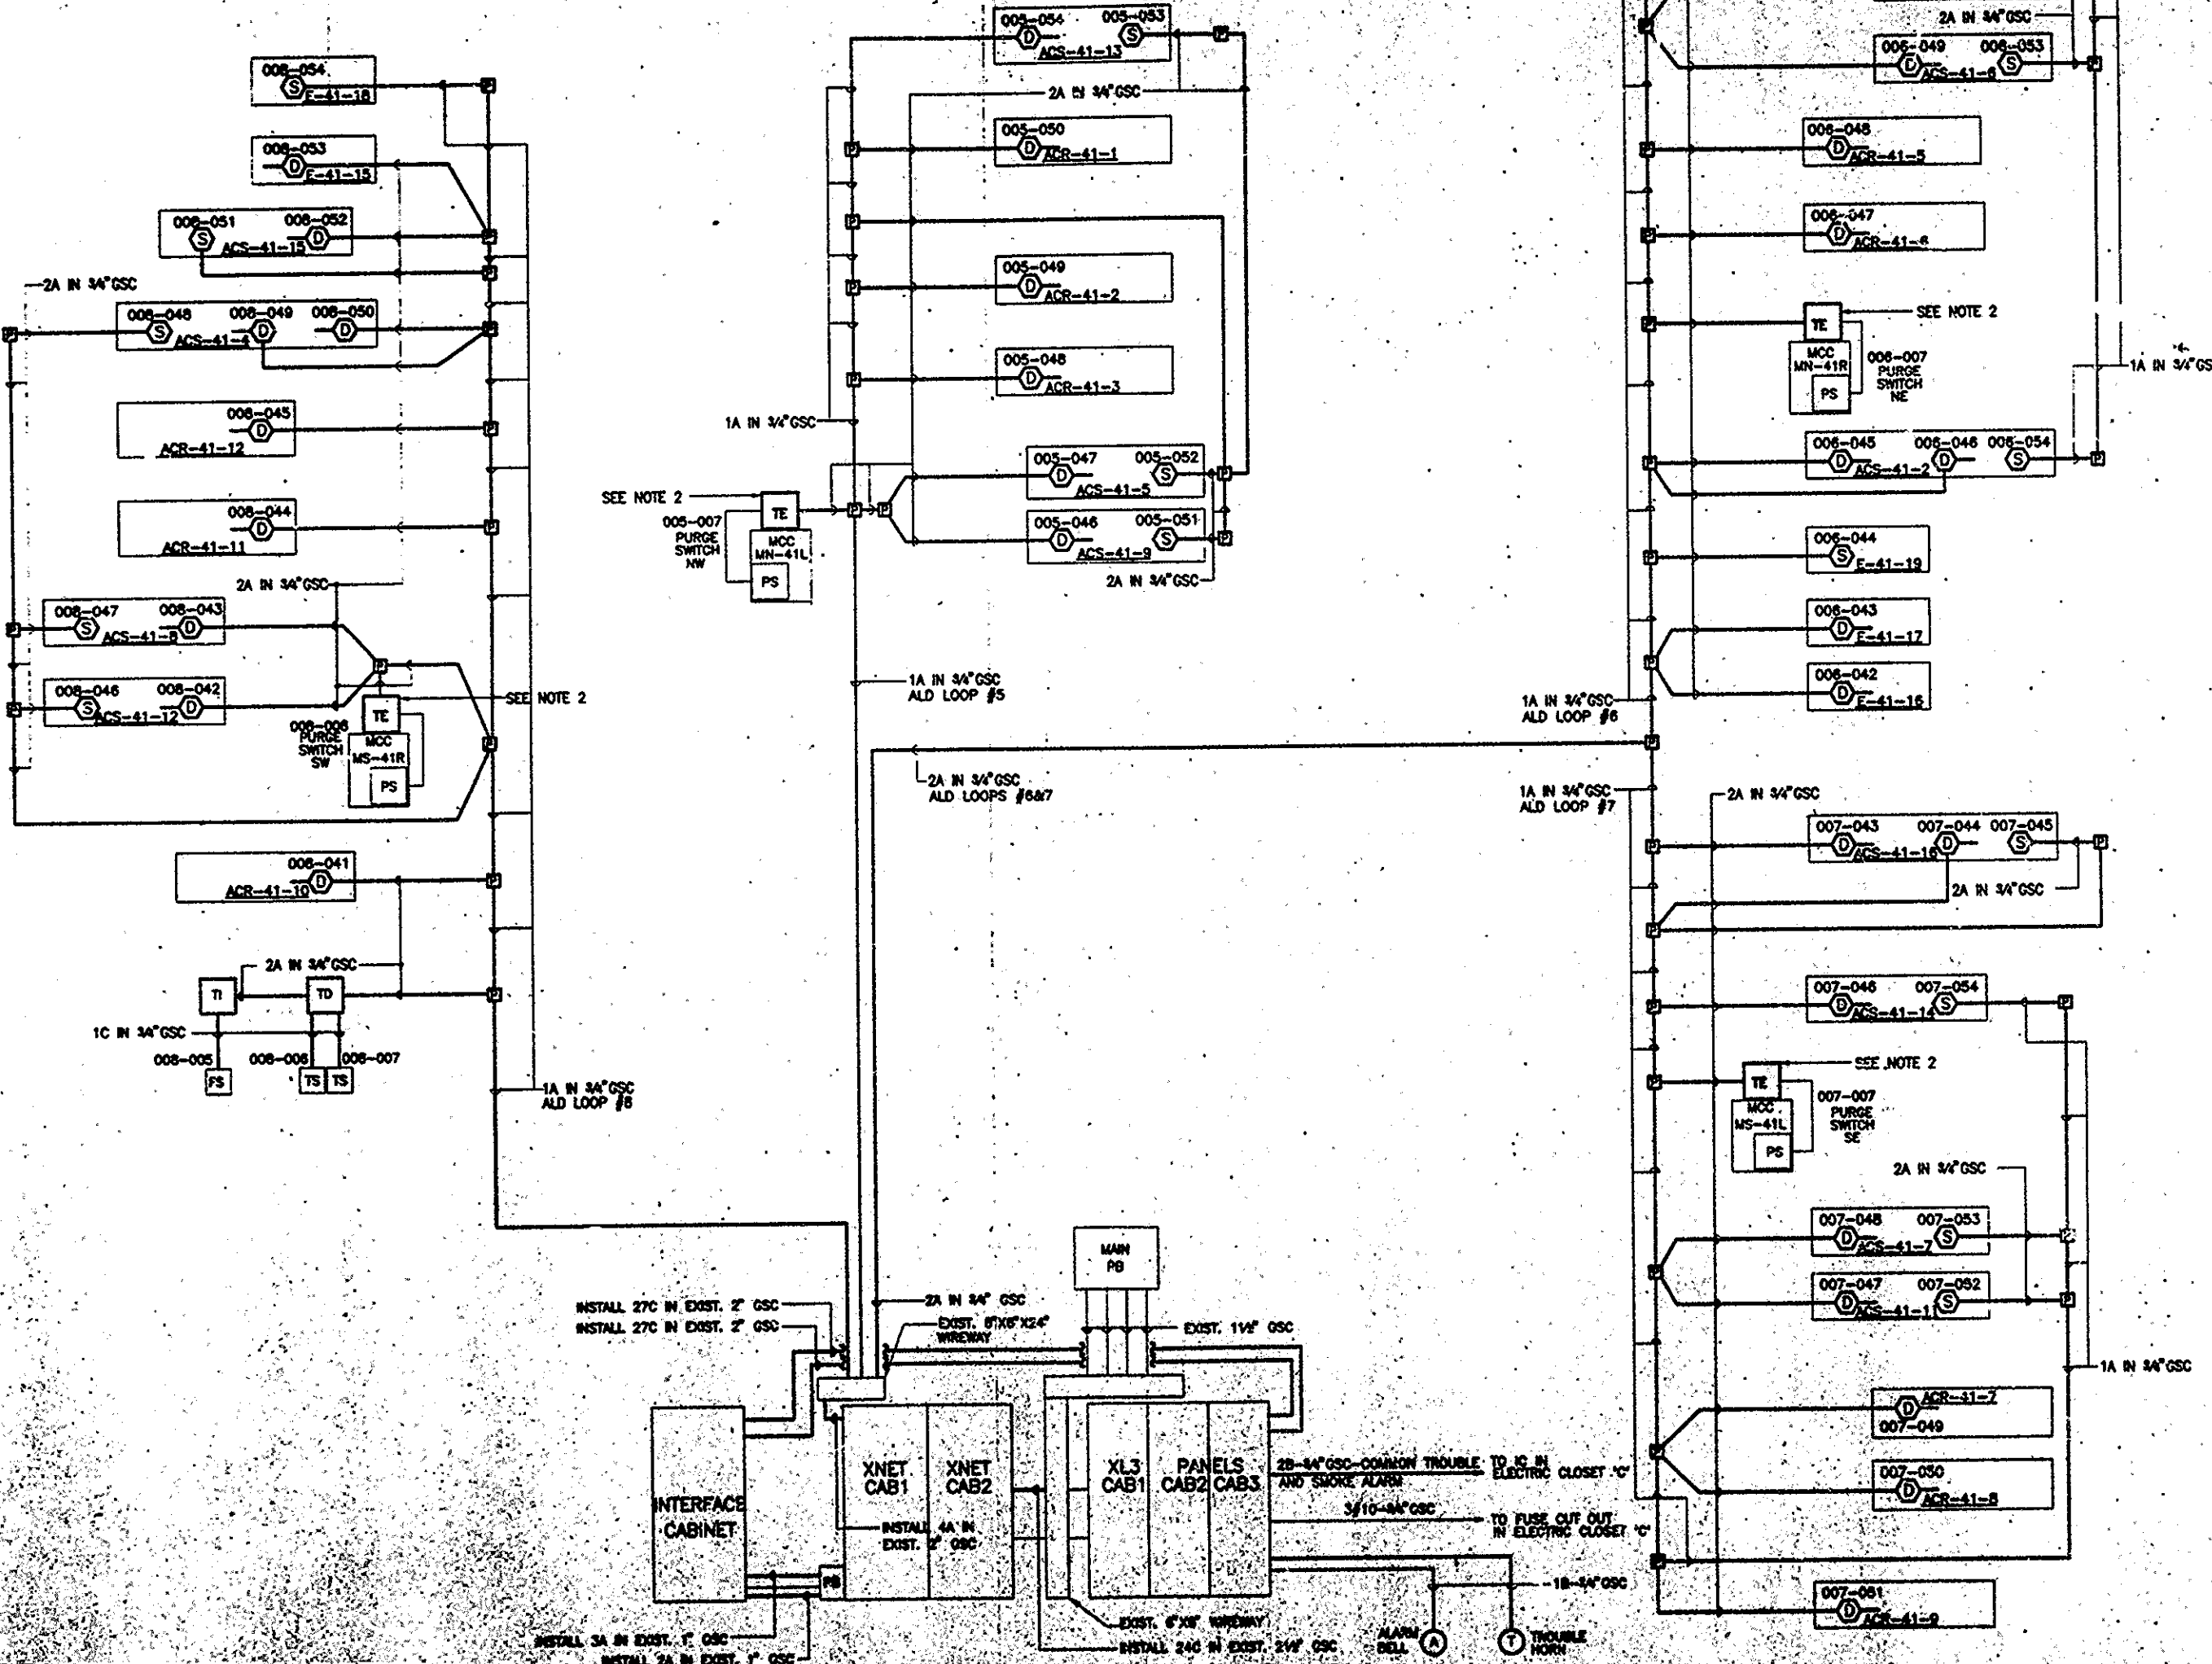

NOTE

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRG AND E.O.L. FROM EXIST BOX LOCATED ABOVE MCC AND INSTALL DB-88 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 41st FLOOR MER PLR, SEE DWG E-11.
4. FOR 41st FLOOR MER REMOVAL PLAN, SEE DWG E-12.

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. NTC-861-08 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/4/00 [Signature]
CONTACT ENGR/ARCH.
DATE 2/3/00 [Signature]
ENGR/ARCH/DOCC/QUAL M

THE FRONT MATTER OF NY 8ND

ENGINEERING PROGRAM MANAGER
WORLD TRADE
G. B. ...
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved
Engineering Department Design Division The World Trade Center			

TITLE

**FIRE ALARM SYSTEM
PHASE III
XL3 CONVERSION
ELECTRICAL
1 WTC
41st FLOOR MER
FIRE ALARM SYSTEM
RISER DIAGRAM**

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority of
New York and New Jersey. No part of this
may not be used without its written consent.

ROYZMAN FELDSTEIN	ROYZMAN	A.S.
Designed by	Drawn by	Checked by

Date 5-20-99 Sect. 7002

Control Number	Dropping Number
WTC-851082	E-10